
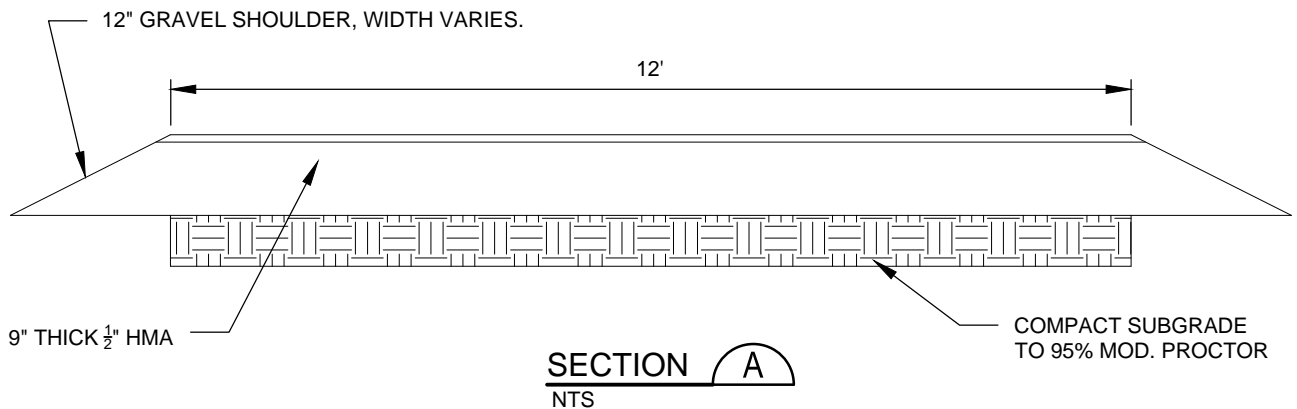


NOTES:

1. 4 INCH OF 1-1/4 INCH MINUS CRUSHED ROCK BASE COURSE PER WSDOT STANDARD SPEC 9-03.9(3).
2. SUBGRADE SHALL BE COMPACTED TO 95% DENSITY AS DETERMINED BY MODIFIED PROCTOR ASTM D 1557. A SOILS REPORT PREPARED BY A REGISTERED PROFESSIONAL ENGINEER SHALL CERTIFY THAT THE ABOVE SECTION IS ACCEPTABLE.

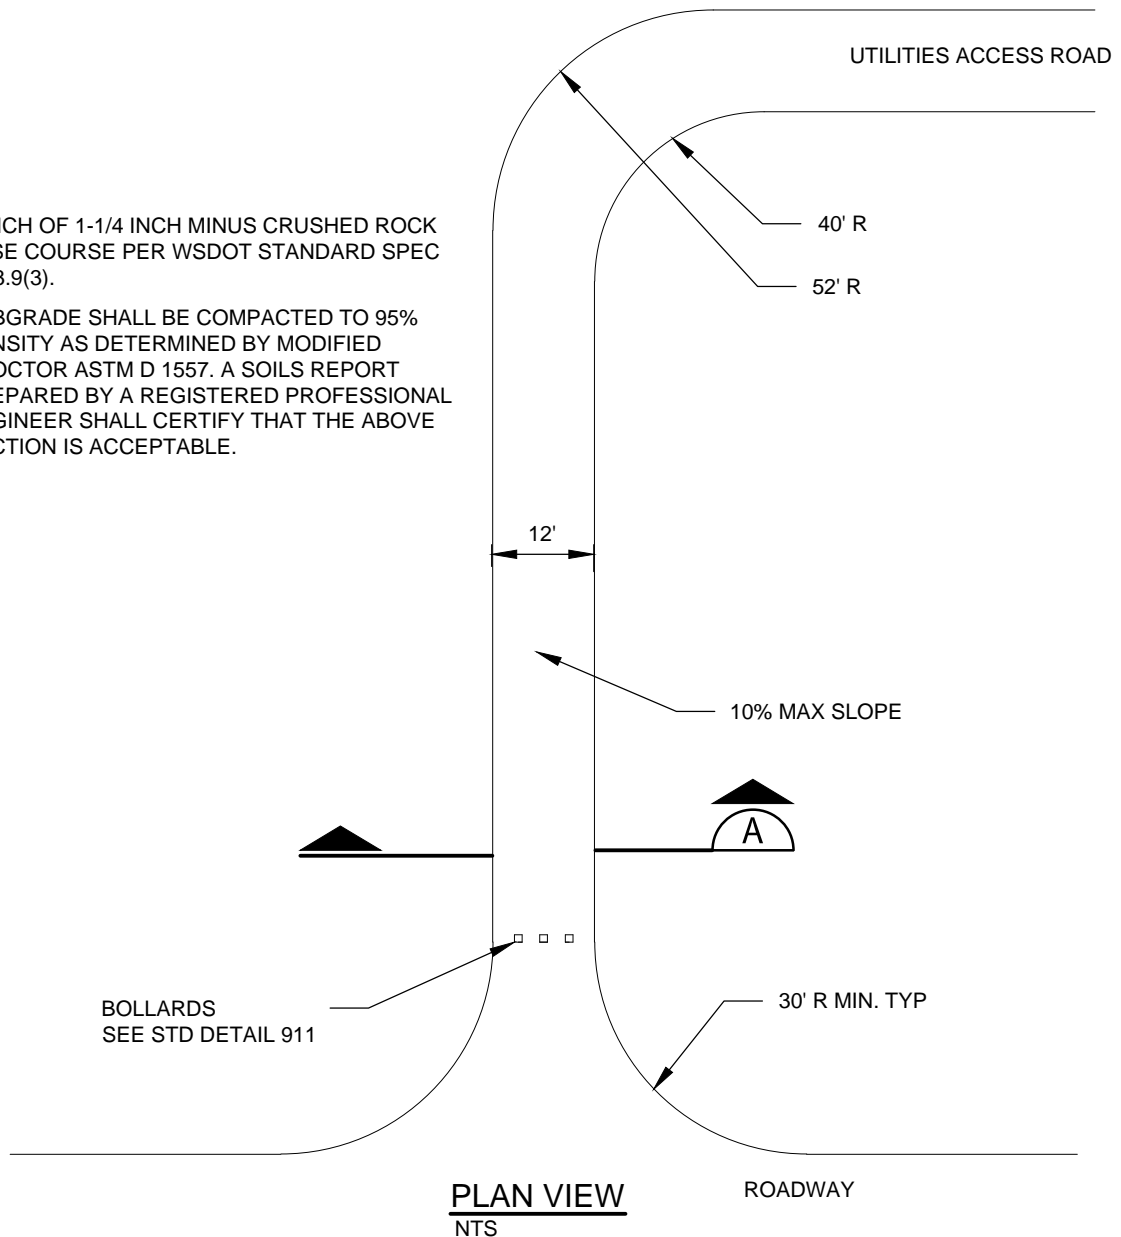

*Gary M. Schimek*

APPROVED BY: GARY M. SCHIMEK  
NATURAL RESOURCES/STORMWATER ENGINEERING MANAGER

REVISION DATE: MARCH 01, 2017



STANDARD DETAILS

STORM / SEWER  
FACILITY ACCESS ROAD

FILE NAME: SDDG11.DWG DETAIL NUMBER: DG11